

# **CONTACTOR RANGE**

# Type **SEC**

RAIL VEHICLES / FIXED INSTALLATION






## **GENERAL INFORMATION**

The **SEC** contactor is a high duty class component, designed to withstand the most severe applications in terms of environment and required performances for rail mobility or fixed installations. Combining high electrical and mechanical endurances, efficient low


current bi-directional blow-out device, and a smart control unit making the SEC operation independent from both ambient temperature and control voltage, the **SEC** is a unique contactor to be used almost regardless of the service conditions.

#### **APPLICATIONS, TYPICAL EXAMPLES**

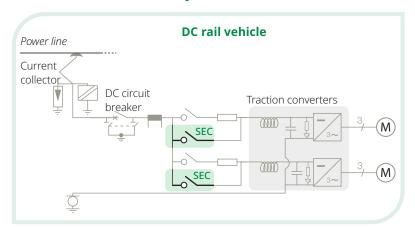

# LINE CONTACTORS FOR DC VEHICLES

Locomotives, trains, EMUs, tramways / Light Rail Vehicles

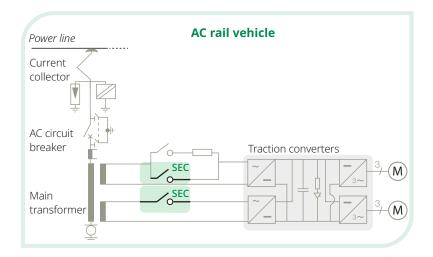

# SEPARATION/LINE CONTACTORS FOR AC VEHICLES

Locomotives, trains and EMUs

#### **MAIN FEATURES**

- Rated operational voltage 900 V to 4,000 V (DC and AC)
- Rated free air thermal current 1,000 A or 1,300 A
- High insulation level (overvoltage category OV3)
- Reference standards: IEC 60077-1 /-2, IEC 61373, EN 50121-3-2, EN 45545, EN 50657.




#### Operational frequency category C3 for 1,000 A and C2 for 1,300 A with a minimum mechanical durability of 2,000,000 operations

- Efficient blow-out circuit for low current interruptions
- Reduced power consumption thanks to a coil controller that controls the closing and opening operations

# **MAIN BENEFITS**

- Closing and opening performances independant from both control voltage level and ambient temperature
- Horizontal or vertical mounting
- Double pair of main contacts allowing a longer life time
- ✓ Low maintenance requirements and easy access to the main contacts for replacement.

#### **CONTACTOR CONFIGURATIONS**

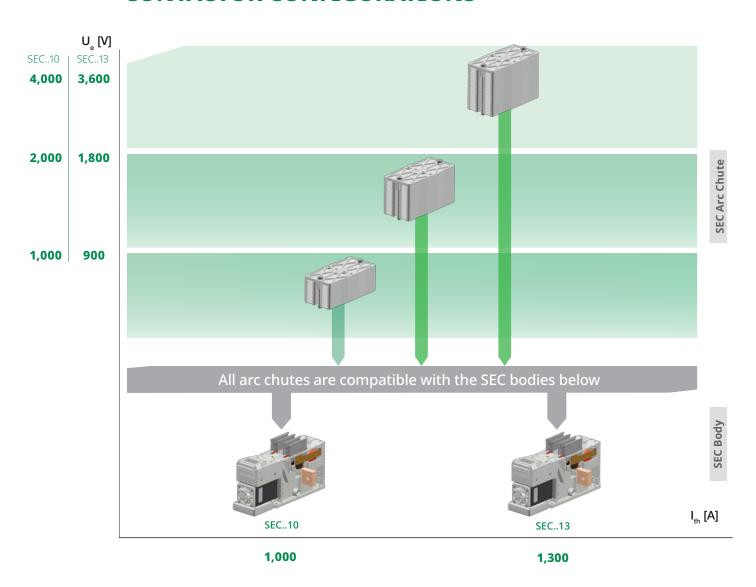



# **DATA FOR PRODUCT SELECTION**

	Symbol	Unit	SEC 10.10	SEC 20.10	SEC 40.10	SEC 09.13	SEC 18.13	SEC 36.13
MAIN HIGH VOLTAGE CIRCUIT								
Component category					А	2		
Type of main contact					Normal	ly Open		
Number of poles					1 p	ole		
Rated operational voltage	$U_{Ni}$	$[V_{DC}/V_{AC}]$	1,000	2,000	4,000	900	1,800	3,600
Rated insulation voltage	$U_{Nm}$	[V]	2,000	2,000	4,000	2,000	2,000	4,000
Conventional free air thermal current (1)	I <sub>th</sub>	[A]		1,000			1,300	
Rated operational current/operational frequency								
- DC voltage or AC voltage (16.7, 25 & 50/60 Hz)	Ir	[A]		1,000 / C3			1,000 / C3	
	Ir	[A]					1,300 / C2	
Rated short-time withstand current	$I_{cw/t}$	[kA]/[ms]			10/	100		
Peak short-time withstand current	Î <sub>cw</sub>	[kA]			1	0		
Maximum breaking capacity								
- DC current, τ = 15 ms	$I_{bc}$	[A]	4,000	3,000	2,500	4,000	3,000	2,000
- AC current, cos Φ = 0.8 (16.7, 25 & 50/60 Hz)	$I_{bc}$	[A]	4,000	3,000	2,500	4,000	3,000	2,000
Maximum making capacity	I <sub>mc</sub>	[A]	4,000	3,000	2,500	4,000	3,000	2,000
Rated power-frequency withstand voltage (50 Hz/1min)								
- Between main contacts (open)	$U_{Ni}$	[kV]	4	1.7	7.9	4	.7	7.9
- Main circuit (closed) to earth	$U_{Ni}$	[kV]	6	5.0	10	6	.0	10
Breaking overvoltage	Ûc	[V]	≤ 2,000	≤ 3,500	≤ 7,000	≤ 2,000	≤ 3,500	≤ 7,00
Overvoltage category			OV3	OV3	OV3	OV3	OV3	OV3
$\frac{1}{10}$ At T <sub>amb</sub> = +40°C and tested with size of high voltage cable co	nnections ne	er terminal: 2	x240mm2 for	r SEC 10 and	3x240 mm2 f	or SEC 13		
LOW VOLTAGE CIRCUITS								
Control circuit								
Nominal supply voltage	Un	[V <sub>DC</sub> ]	[24 - 36] or [48 - 110]					
Control voltage	U <sub>EF</sub>	[V <sub>DC</sub> ]	24 to 110					
Range of voltage	- EF	[.bc]	[0.7 - 1.25] U <sub>n</sub>					
Nominal closing power (3)	P <sub>c</sub>	[W]				0 (2)		
Nominal holding power (3)	P <sub>m</sub>	[W]	≤ 4					
Input control current (3)	' m	[mA]	10 (24 V <sub>DC</sub> ) to 2 (110 V <sub>DC</sub> )					
Mechanical closing time (3)	t <sub>cc</sub>	[ms]	100	100	130	100	100	130
Mechanical opening time (3) (4)	t <sub>co</sub>	[ms]				0		
		mode epeni	ng +10 mc 20	dditional timo	for closing +6	O me addition	al timo	
Auxiliary contacts	direct control	mode openi	ing i to this ac	uditional time,	TOT Closing To	io ilis additioi	iai tiirie.	
Type of contacts					Dotontial	free (PF)		
		D / 3				220		
Rated voltage	T	[V <sub>DC</sub> ]						
Conventional thermal current	$I_{th}$	[A]			I	0		
Utilization categories according to EN60947					4.6			
AC-15 230 V <sub>AC</sub>						) A - ^		
DC-13 110 V <sub>DC</sub>		F A 7		. 10 (.:1		5 A	Lil t t . X	
Minimum let-through current at 24 V <sub>DC</sub> <sup>(5)</sup>		[mA]		≥ 10 (Sliver	contacts) or 4	4≤1<10(go	id contacts)	
(5) For a dry and clean environment.								
Low voltage interface								
Control circuits & Auxiliary switches				Termina	al block or AM	1P 18 pins co	nnector	
Low voltage interface								
Rated power-frequency withstand voltage (50 Hz / 1min)								
nated power frequency with starta voltage (50 HZ / HIIIII)	U <sub>a</sub>	[kV]			1.	.5		
- LV circuit to earth								
- LV circuit to earth  OPERATING CONDITIONS  Installation					Ind	loor		
OPERATING CONDITIONS Installation Altitude		[m]				loor 000		
OPERATING CONDITIONS Installation	$T_{amb}$	[m] [°C]			≤ 2,			
OPERATING CONDITIONS Installation Altitude	T <sub>amb</sub>				≤ 2, -40 to	000		
OPERATING CONDITIONS Installation Altitude Working ambient temperature	T <sub>amb</sub>				≤ 2, -40 to 95% at	000 > +70		




## **PRODUCT INTEGRATION**

#### **MAIN DIMENSIONS**


HV connections	M12 screws
Earth connections	M6 screws
LV Connections	M3 screws terminal block
	or AMP connector (option)
Fixing points	M8 Screws


Dimensions without tolerances are indicative. All dimensions are in mm. The maximum allowed flatness deviation of the support frame is 0.5 mm.

#### / High voltage lateral connections

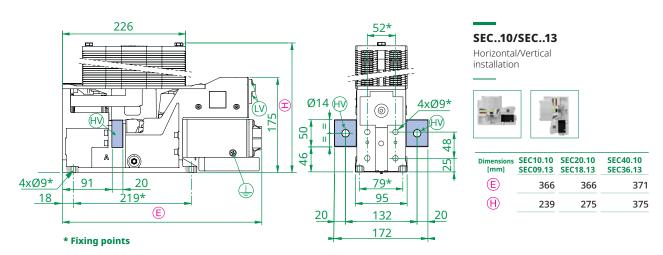

#### **INSULATION DISTANCES AND WEIGHTS**





**SEC** contactors have been homologated according to IEC 60077-2 with the following insulation distances.

	Insulating distance [mm]						
	To insulating wall						
	Α	B <sup>(3)</sup>	С	D			
SEC10.10 SEC09.13	30 <sup>(1)</sup> /50 <sup>(2)</sup>	50 <sup>(1)</sup> /100 <sup>(2)</sup>	20(1)/30(2)	50 <sup>(1)</sup> /100 <sup>(2)</sup>			
SEC20.10 SEC18.13	30 <sup>(1)</sup> /50 <sup>(2)</sup>	50 <sup>(1)</sup> /100 <sup>(2)</sup>	20 <sup>(1)</sup> /50 <sup>(2)</sup>	50 <sup>(1)</sup> /100 <sup>(2)</sup>			
SEC40.10 SEC36.13	30 <sup>(1)</sup> /50 <sup>(2)</sup>	100 <sup>(1)</sup> /200 <sup>(2)</sup>	50 <sup>(1)</sup> /80 <sup>(2)</sup>	100(1)/200(2)			

Weight: ± 1 kg	
11	
12.5	
16	

- (1) Clearance against insulating wall.
- (2) Clearance against earth.
- (3) For breaking current ≤ 2kA (≤ 1kA for SEC40.10 and SEC36.13). For higher breaking conditions please contact Sécheron.



#### **LOW VOLTAGE CONTROL DIAGRAM**

#### // Low voltage control mode

The two control modes that can be used to control the SEC are represented hereunder:

- Indirect mode
- Direct mode

#### Required data for k0 and k1 control relays:


	Nominal supply voltage U <sub>n</sub> [V <sub>DC</sub> ]	Î <sub>pl</sub> [A]	Î <sub>h</sub> [A]	I <sub>sb</sub> [mA]	I <sub>pk</sub> [mA]
Required data	24-36	4.5	0.85	≤ 30	< 500
K <sub>0</sub> relays (1)	48-110	2.5	0.45	≥ 30	≥ 500

	Nominal control voltage $U_{\rm EF}[V_{ m DC}]$	
Required data K <sub>1</sub> relays <sup>(1)</sup>	24	~10
	110	~2

# DC / DC converter SEC closing coil C

NON ISOLATED CONTROL INPUT

#### INDIRECT MODE



# DC / DC converter + k0 SEC closing coil F U<sub>EF</sub>

**ISOLATED CONTROL INPUT** 

Sécheron's scope
Customer's scope
Low voltage interface

Coil controller

Opto-isolator

Opto-isolator -

U<sub>n</sub> : DC power supply
U<sub>EF</sub> : Control voltage (1)
k<sub>0</sub> : Supply relay
k<sub>1</sub> : Control relay

#### Notes:

Isolated or non isolated control mode is to be determined when ordering. Please refer to codification page 12.

In case the customer needs to have the full electrical compatibility with former coil controller version, the "Non isolated control input" version must be ordered.


(1) Control voltage (U<sub>EF</sub>) can be different from supply voltage (U<sub>n</sub>).




#### NON ISOLATED CONTROL INPUT

# DC / DC converter SEC closing coil Opto-isolator


#### **DIRECT MODE**




#### Wiring diagram with 2a + 2b auxiliary switches (Configuration 1) - Standard

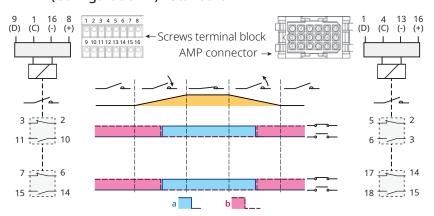

#### Legend of the schemes:



#### Wiring diagram with 2a + 2b auxiliary switches (Configuration 2) - Option

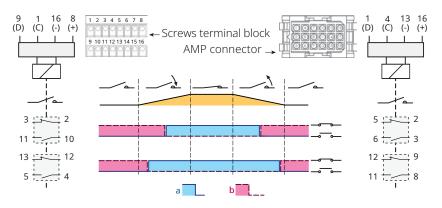


#### Notes:

Difference between configuration 1 & 2 relates to the switching offset time between auxiliary switches.




#### // Wiring diagram with 3a + 3b auxiliary switches (Configuration 3) - Option

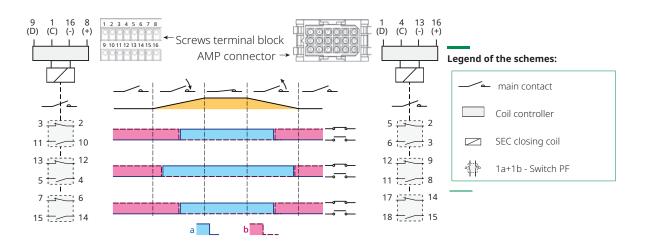

# **OPTIONS** (SUBJECT TO ADDITIONAL COSTS)

#### **LOW VOLTAGE AMP CONNECTOR**



can be ordered separately.

The low voltagwe AMP mobile connector


Mobile connectors				
Туре	Secheron's number			
AMP connector 18 pins for 0.5 mm <sup>2</sup>	SG201013R1			
AMP connector 18 pins for 1.5 mm <sup>2</sup>	SG201013R2			




#### **LOW VOLTAGE AMP CONNECTOR**


HV connections	M12 screws
Earth connections	M6 screws
LV Connections	M3 screws terminal block
	or AMP connector (option)
Fixing points	M8 Screws


#### / Dimensions, Insulation distances and weights

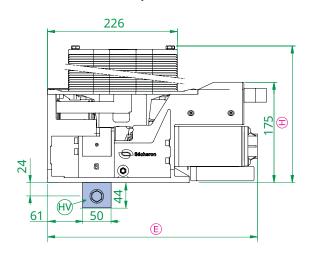



Dimensions [mm]	SEC10.10 SEC09.13	SEC20.10 SEC18.13	SEC40.10 SEC36.13
E	366	366	371
$\bigoplus$	239	275	375
Weight	12 kg	13.5 kg	17 kg

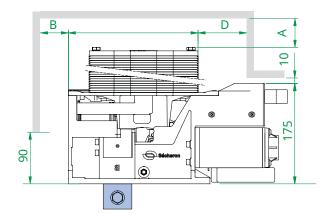



Dimensions [mm]	SEC10.10 SEC09.13	SEC20.10 SEC18.13	SEC40.10 SEC36.13
Α	30(1)/50(2)	30(1)/50(2)	30(1)/50(2)
B <sup>(3)</sup>	50(1)/100(2)	50(1)/100(2)	100(1)/200(2)
C	20(1)/30(2)	20(1)/50(2)	50(1)/80(2)
D	50(1)/100(2)	50 <sup>(1)</sup> /100 <sup>(2)</sup>	100(1)/200(2)
Weight	12 kg	13.5 kg	17 kg

<sup>(1)</sup> Clearance against insulating wall.


<sup>(2)</sup> Clearance against earth.

<sup>(3)</sup> For breaking current ≤ 2kA (≤ 1kA for SEC40.10 and SEC36.13). For higher breaking conditions please contact Sécheron.



# **SECHERON CONTACTORS RANGE**


U [V= / V~]

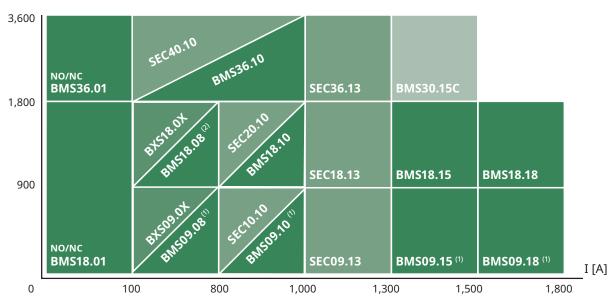

**BMS15.002** and **HS** contactors are still available on request for delivery for repeat order or as spares.

(1) BMS09... can be used for rated voltages up to 2,000 V<sub>AC</sub>  $^{\rm (2)}$  A specific version of BMS18.08 can also be used for rated voltage up to 4,000  $V_{\rm AC}$ 



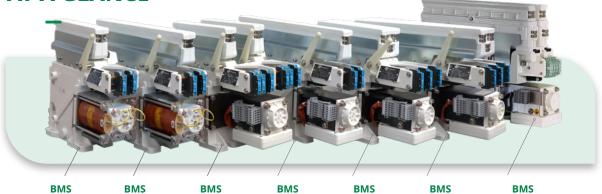

**BMS** 09.08 1 pole Arc chute

Type A

18.08 1 pole Arc chute Type A

09.08 2 poles Arc chute Type A

18.10 1 pole Arc chute Type A

09.15 1 pole Arc chute Type A

18.18 1 pole Arc chute Type A

**BMS** 36.10 1 pole



SEC10.10/ SEC09.13

SEC20.10/ SEC40.10/ SEC18.13 SEC36.13



BMS18.01

BMS36.01



# BROCHURE REFERENCE FOR OTHER SÉCHERON'S CONTACTORS



#### BMS..08/BMS..10 Type

#### **ROLLING STOCK**

(Line/separation contactors, ...).

#### **FIXED INSTALLATION**

(depot feeder contactor...).



#### BMS..08 3-pole Type

#### ROLLING STOCK

(Line/separation contactors, ...).

#### **FIXED INSTALLATION**

(depot feeder contactor, ...).



#### **BMS..15/BMS..18** Type

**ROLLING STOCK** (Line/separation contactors, ...).

#### FIXED INSTALLATION

(depot feeder contactor...).



#### **SEC** Type

#### **ROLLING STOCK**

(Line/separation contactors, PM motor,...).

#### FIXED INSTALLATION

(depot feeder contactor, ...).



#### **BMS15.002** Type

#### **ROLLING STOCK**

(Pre-charging, Heating, HVAC, ...).

#### FIXED INSTALLATION

(Line testing, ...).



#### BMS30.15C Type

#### **ROLLING STOCK**

(Line/separation contactors, ...).

#### **FIXED INSTALLATION**

(depot feeder contactor, ...).



#### **HS** Type

#### ROLLING STOCK

(Pre-charging, Heating, HVAC, ...).

#### FIXED INSTALLATION

(Line testing, ...).

## **DESIGNATION CODE FOR ORDERING**

- Be sure to establish the designation code from the latest version of our brochure by downloading it from the website: www.secheron.com.
- Be careful to write down the complete alphanumerical designation code with 12 characters when placing your order.
- For technical reasons some variants and options indicated in the designation code might not be combined, therefore validate your configuration with Sécheron before ordering.
- For other configurations not described in the brochure, please contact Sécheron.

Example of customer's choice:	SEC	10	10	01	S	1	Ø	
Line:	10	11	12	13	14	15	16	

• The bold characters of the designation code define the device type.

#### **DESIGNATION CODE**

Description		Designation	Standard	Options	Customer's choice
Product type BMS		SEC	SEC		SEC
Rated operational voltage		1,000 V	10		
		2,000 V	20		
		4,000 V	40		
		900 V	09		
		1,800 V	18		
		3,600 V	36		
Rated conventional free air	thermal current (1)	(1,000; 2,000 and 4,000 V) 1,000 A	10		
		(900; 1,800 and 3,600 V) 1,300 A	13		
High voltage connections		Lateral	01		
		Bottom with screws		02	
Nominal supply voltage - co	ntrol mode	24 to 36 $V_{DC}$ - Isolated	Р		
		48 to 110 $V_{DC}$ - Isolated	S		
				L	
				M	
Auxiliary contacts		31	1		
		3 31			
I ow voltage interface	Su Su (SWICCITT)	3 71	Ø	3	
zon ronage meer lace			2	1	
	Rated operational voltage Rated conventional free air High voltage connections	Rated operational voltage  Rated conventional free air thermal current (1)  High voltage connections  Nominal supply voltage - control mode  Auxiliary contacts	Rated operational voltage 1,000 V 2,000 V 4,000 V 900 V 1,800 V 3,600 V 3,600 V 3,600 V 1,800 V 3,600 V 1,800 V 3,600 V 1,800	Rated operational voltage	Rated operational voltage

<sup>(1)</sup> At Tamb = +40°C

The low voltage connector must be ordered separately (refer to above description):

None AMP connector 18 pins of 0.5 mm<sup>2</sup> SG201013R1

AMP connector 18 pins of 1.5 mm<sup>2</sup> SG201013R2





#### Sécheron SA

Rue du Pré-Bouvier 25 1242 Satigny - Geneva CH-Switzerland

#### www.secheron.com

Tel: +41 22 739 41 11 Fax: +41 22 739 48 11 ess@secheron.com